


CMCP1000C-XX-XX-XX

Class 1 Division 1 Explosion Proof Vibration Monitoring System


Shown with built in accelerometer, optional power supply and optional external reset switch

Right Side (Lid Installed)

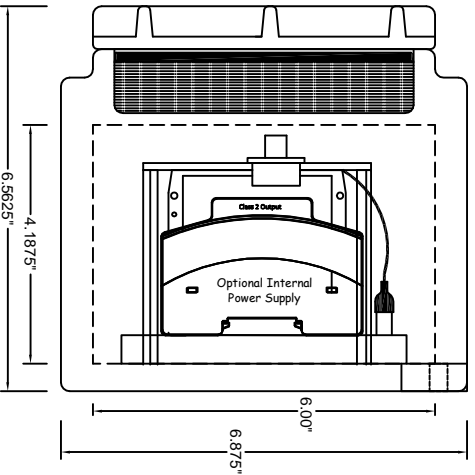


Note:
Mounting Foot on Top When
Looking From Right

Front Top

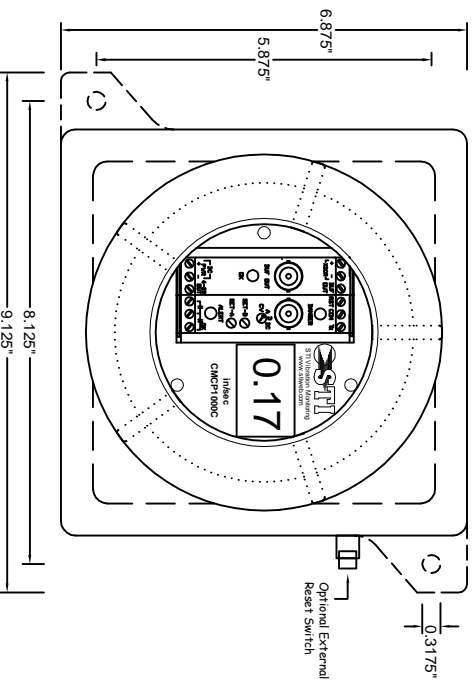

Left Side (Lid Not Installed)

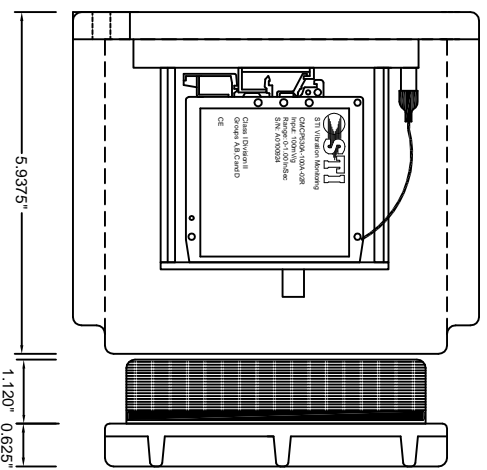

Note:
Mounting Foot on Bottom When
Looking From Left



- 1
- 2
- 3
- 4
- 5

THIS DOCUMENT IS PROPERTY OF STI AND CANNOT BE REPRODUCED OR
 TRANSMITTED IN ANY FORM OR BY ANY MEANS WITHOUT THE WRITTEN
 PERMISSION OF STI. THIS DOCUMENT IS THE PROPERTY OF STI AND CANNOT
 BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS WITHOUT
 THE WRITTEN PERMISSION OF STI.

| REV | DATE | DESCRIPTION |
|-----|------|-------------|
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |

| | | | |
|---|---------------|--------------------------|------|
| CUSTOMER | | STI Vibration Monitoring | |
| LOCATION | | CMCP1000C | |
| ORDER NO. | SR. NO. | DATE | REV. |
| | | 7/16/10 | A |
| UNLESS OTHERWISE SPECIFIED ALL DIMENSIONS ARE IN INCHES. | | SCALE | NONE |
| TOLERANCES | | | |
| FRACTIONS | DECIMALS | ANGLES | |
| .XX ± 0.01 | .XXX ± 0.005 | ± 10 | |
| ± 1/64 | .XXX ± 0.0005 | | |