CMCP730D

Universal Signal Conditioner/Relay Module with LCD Display

Whilst every effort has been taken to ensure the accuracy of this document, we accept no responsibility for damage, injury, loss or expense resulting from errors or omissions, and reserve the right of amendment without notice.

STI Vibration Monitoring

This document may not be reproduced in any way without the prior written permission of the company.

January 2021

CONTENTS

<i>1</i> .	INTRODUCTION	3
1.1	Hardware Features	3
1.2	Isolation Details	3
<i>2</i> .	UNPACKING	3
<i>3</i> .	QUICK START GUIDE	
4.	CONNECTIONS	5
<i>5</i> .	CONFIGURING THE CMCP730D	7
5.1	Voltage Input:	8
5.2	Current Input	9
5.3	Millivolt (mV) Input	10
5.4	Potentiometer Input	11
5.5	Thermocouple Input	12
5.6	RTD Input	13
5.7	Output Configuration	14
6.	CALIBRATING THE CMCP730D	15
6.1	Main menu and Set Point menu	15
6.2	Set Points 1 and 2, Hysteresis Points 1 and 2	17
6.3	Relay 1 and Relay 2	17
6.4	Led 1 and Led 2	18
6.5	Output Span and Output Zero	18
6.6	Input Units	18
6.7	Input Span and Zero	19
6.8	Relay Test	19
6.9	Output Options	19
6.10	0 Relay Time Delays	20
<i>7</i> .	INSTALLATION	22
<i>8</i> .	TROUBLESHOOTING	23
8.1	Incorrect Reading	23
8.2	Sensor Failure	23
9.	SPECIFICATIONS (@) 25°C)	24

STI Vibration Monitoring Ltd 1010 East Main Street League City, TX 77573 www.stiweb.com

1. INTRODUCTION

1.1 Hardware Features

The CMCP730D is a universal input dual trip amplifier with isolated retransmitted output. It can accept virtually every type of analogue input signal from millivolts to 40Vdc, mA, thermocouples, RTD's etc. It produces 2 types of analogue output; voltage and mA source. It has 2 configurable trip action relay outputs, with optional latching operation and a variety of time delay options.

The input value and setpoints can be viewed on a 4 digit display which is also used to display menu options when the unit is configured.

The unit can be powered by any DC voltage between 16 and 36Vdc or 16 and 32Vac.

The instrument is packaged in a compact 22.5mm wide enclosure which can be mounted on standard TS35 DIN-rail.

1.2 Isolation Details

The CMCP730D has full 3 port isolation of 1000V between the Input Stage, Output Stage and Power Supply for functional reasons.

2. UNPACKING

The instrument should be carefully inspected for signs of damage which may have occurred in transit. In the unlikely case that damage has been sustained, DO NOT use the instrument, but please retain all packaging for our inspection and contact your supplier immediately.

The instrument comes with the following items as standard:

- 1 CMCP730D Isolating Dual Trip Signal Converter
- 1 CMCP730D User Guide

Unless otherwise noted, the default configuration is 4-20mA input and 4-20mA source output. Relay 1 will energise above 16mA, relay 2 will energise below 8mA. The other default options are listed in section 5. If re-configuration is required please refer to sections 4 and 5 of this manual.

3. QUICK START GUIDE

This example shows how easy it is to configure a CMCP730D with 4-20mA Input, 0-10V Output, 0-100% on display.

Before starting, make sure power supply, inputs and outputs are disconnected.

Open the CMCP730D case and slide out the PCB (see page 6

Set up the input switches to the required input type and range (see pages 7-12 For 4-20mA Input, S1: 2,3,9,10,11,12 on and S2: 1,2,7,8 on (S2 closest to relays Set up the output switch to mA or voltage (see page 13

For 0-10V Output the switch should be on (yellow switch closest to edge of PCB

Refit the PCB, connect up inputs, outputs and power then switch on (see page 5

Access the main menu (see page 14 then push raise to cycle up to 7. Output Span Apply full scale input value (20 mA

Push & release both buttons to enter Span Adjust sub menu and adjust output (10V Push & release both buttons to return to main menu

Push raise to cycle up to 8. Output Zero

Apply zero scale input value (4 mA

Push & release both buttons to enter Zero Adjust sub menu and adjust output (0V Push & release both buttons to return to main menu

Push raise to cycle up to 9. Input Units

Push & release both buttons to enter Input Units sub menu & select units (% 2 DP Push & release both buttons to return to main menu

Push raise to cycle up to 11. Input Span

Push & release both buttons to enter Input Span sub menu and adjust value to match the full scale input value used when 7. Output Span was adjusted (100.00% Push & release both buttons to return to main menu

Push raise to cycle up to 12. Input Zero

Push & release both buttons to enter Input Zero sub menu and adjust value to match the zero scale input value used when 8. Output Zero was adjusted (0.00% Push & release both buttons to return to main menu


Inputs, outputs and input display are all calibrated now. Set Point 1 is 16.00%, Set Point 2 is 8.00%. Use the other main menu options to adjust parameters as required

(see pages 14-20. When all changes have been made, return to run mode from main menu by pushing and holding both buttons until OK is displayed then release.

4. CONNECTIONS

The CMCP730D is housed in a compact DIN rail mounting enclosure, with 16 terminals, arranged in 4 rows of 4 terminals. Two rows are at the top of the front panel and 2 rows are at the bottom. The relay terminals are on the top row and the sensor input terminals and the power supply and analogue outputs are on the bottom rows.

The diagram below shows how to connect all the different input, output and power supply types.

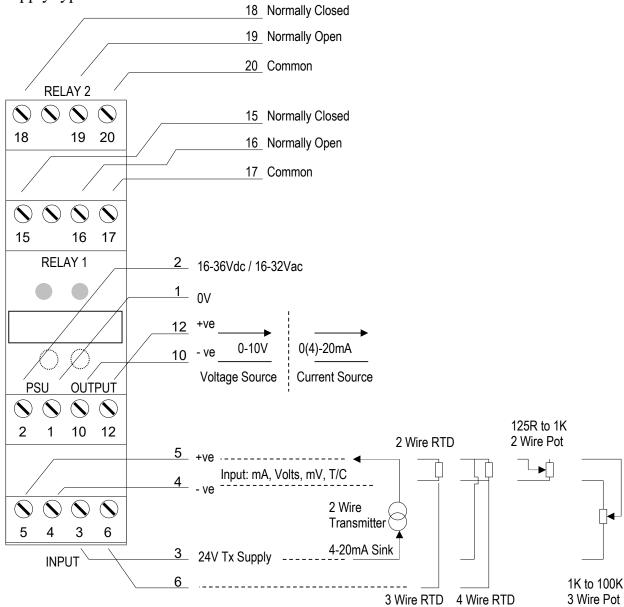

Page 5


5. CONFIGURING THE CMCP730D




! WARNING! DO NOT OPEN UNIT OR ADJUST SWITCHES WITH POWER SUPPLY, INPUT OR OUTPUT CONNECTED

The CMCP730D is an extremely versatile device which can support many different types of input. The unit is configured by turning the power off, selecting the internal switch settings required and turning the power back on. Further options are chosen using the menu system via the display.

To open the CMCP730D, 2 catches just below the outer terminal blocks must be pushed in gently, one at a time. The front of the case can then be pulled and the unit will come out of the box.



There are 2 switch banks, S1 and S2, a link L201 and a single switch S3 located inside the CMCP730D as shown below:

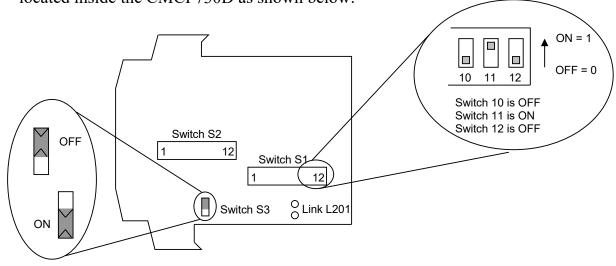

Switch S1, S2 and Link L201 configure the input type and range, and switch S3 configures the output type. The switch settings are explained in the next few pages. The diagrams refer to switch positions 0 and 1, with 0 being OFF and 1 being ON. This is illustrated in the picture above.

5.1 Voltage Input:

Select the range from the table below and set Switch S1 to the required values.

Voltage		Switch S1												
Range														
	1	2	3	4	5	6	7	8	9	10	11	12		
0-1V	0	0	0	0	0	1	0	0	1	1	0	0		
0-2V	0	0	0	1								0		
0-4V	0	0	1	0								0		
0-5V	0	1	0	0								0		
0-7.5V	1	0	0	0								0		
0-8V	0	0	1	1								0		
0-10V	0	1	0	1								0		
0-15V	1	0	0	1								0		
0-20V	0	1	1	0								0		
0-30V	1	0	1	0								0		
0-40V	0	1	1	1								0		
1-5V	0	1	0	0								1		
-5 to +5V	1	1	0	0				\downarrow				1		
-10 to +10V	1	1	0	1	0	1	0	0	1	1	0	0		

Then select the required setting from the table below for switch S2.

		Switch S2											
Voltage Range													
	1	2	3	4	5	6	7	8	9	10	11	12	
0-30V & 0-40V Ranges All other Ranges	0	0	1	1	0	0	1	1	0	0	0	0	
Listed Above	0	0	1	0	1	0	1	0	0	0	0	0	



5.2 Current Input

Select the range from the table below and set Switch S1 to the required values.

		Switch S1										
mA Range												
	1	2	3	4	5	6	7	8	9	10	11	12
0-1mA	0	0	0	0	0	0	0	0	1	1	1	0
0-2mA	0	0	0	1				~			_	0
0-4mA	0	0	1	0								0
0-5mA	0	1	0	0								0
0-8mA	0	0	1	1								0
0-10mA	0	1	0	1								0
0-15mA	1	0	0	1								0
0-20mA	0	1	1	0								0
0-30mA	1	0	1	0								0
4-20mA	0	1	1	0								1
4-40mA	0	1	1	1								1
4-30mA	1	0	1	0								1
-5 to +5mA	1	1	0	0				▼				1
-10 to +10mA	1	1	0	1	0	0	0	0	1	1	1	0

Then select the required setting from the table below for switch S2.

	Switch S2											
mA Range												
	1	2	3	4	5	6	7	8	9	10	11	12
Using Internal 24V												
Tx Supply for 4 to												
20mA	1	1	0	1	0	0	1	1	0	0	1	0
transmitter												
a di lomito												
Unipolar Ranges												
(e.g. 0-20mA,												
4-20mA)	1	1	0	Λ	0	Λ	1	1	Λ	0	0	0
4-2011/4)	'	•	U	U	U	U	•	•	U	U	U	١
Pipolar Pangos												
Bipolar Ranges												
(e.g.			^	^		^		^	_	_	^	ا ر
-10 to +10mA)	1	1	U	U	1	U	1	U	U	Ü	U	U



5.3 Millivolt (mV) Input

Select the range from the table below and set Switch S1 to the required values.

_	Switch S1											
mV Range												
	1	2	3	4	5	6	7	8	9	10	11	12
0-25mV	0	0	0	0	0	0	0	1	1	1	0	0
0-50mV	0	0	0	1								_
0-100mV	0	0	1	0								
0-125mV	0	1	0	0								
0-150mV	1	0	0	0								
0-200mV	0	0	1	1								
0-250mV	0	1	0	1								
0-300mV	1	0	0	1								
0-500mV	0	1	1	0								
0-600mV	1	0	1	0								
0-1000mV	0	1	1	1								
0-1200mV	1	0	1	1								
-125 to +125mV	1	1	0	0				1	7			
-125 to +1000mV	1	1	1	1	0	0	0	1	1	1	0	0

And then select the required setting from the table below for switch S2.

		Switch S2											
mV Range													
	1	2	3	4	5	6	7	8	9	10	11	12	
All Unipolar Ranges (e.g. 0-500mV)	0	1	0	0	0	0	1	1	0	0	0	0	
Bipolar Ranges (e.g.													
-125 to +125mV)	0	1	0	0	1	0	1	0	0	0	0	0	



5.4 Potentiometer Input

Select the range from the table below and set Switch S1 to the required values.

Potentiometer		Switch S1											
Input													
	1	2	3	4	5	6	7	8	9	10	11	12	
2 Wire 0-125R	0	0	0	0	0	0	0	1	1	1	0	1	
2 Wire 0-250R	0	0	0	1	_								
2 Wire 0-500R	0	0	1	0									
2 Wire 0-625R	0	1	0	0									
2 Wire 0-750R	1	0	0	0				1	7				
2 Wire 0-1K	0	0	1	1	0	0	0	1	1	1	0	1	
If option fitted:													
3 Wire from													
0-1K to 0-100K	0	0	0	0	0	1	0	1	1	1	1	0	

Then select the required setting from the table below for switch S2.

Potentiometer		Switch S2											
Input													
	1	2	3	4	5	6	7	8	9	10	11	12	
2 Wire													
Potentiometer	0	1	0	0	1	0	0	1	0	0	0	1	
If option fitted:													
3 Wire	ALSO FIT LINK L201												
Potentiometer	er 0 0 1 1 0 0 1 1 0 0 1									0			

Please note that to use a 3 wire pot input link L201 must be fitted (see diagram on page 6 for its location).



5.5 Thermocouple Input

Select the range from the table below and set Switch S1 to the required values.

		Switch S1	for '	Ther	moc	oupl	e In	put							
Tempe	rature Range	in °C	Swi	tch											
KJRSNE	В	T	1	2	3	4	5	6	7	8	9	10	11	12	
0 to 100	400 to 500	0 to 50	0	0	0	0		0	0		0	Ĺ	$\overline{}$	(
0 to 200	400 to 600	0 to 100	0	0	0	1			$\overline{}$						
0 to 400	400 to 800	0 to 200	0	0	1	0									T/C
0 to 800	400 to 1200	0 to 400	0	0	1	1							*		Type
0 to 125	400 to 525	-50 to 50	0	1	0	0						0	0	0	K
0 to 250	400 to 650	-50 to 100	0	1	0	1						0	0	1	J
0 to 500	400 to 900	-50 to 200	0	1	1	0						0	1	0	R
0 to 1000	400 to 1400	-50 to 400	0	1	1	1						0	1	1	S
0 to 150	400 to 550	-100 to 50	1	0	0	0						1	0	0	N
0 to 300	400 to 700	-100 to 100	1	0	0	1						1	0	1	E
0 to 600	400 to 1000		1	0	1	0						1	1	0	В
0 to 1200*	400 to 1600	-100 to 400	1	0	1	1						1	1	1	Т
0 to 175	400 to 575	-200 to 50	1	1	0	0									
0 to 350	400 to 750	-200 to 100	1	1	0	1		_			\perp				
0 to 700	400 to 1100	-200 to 200	1	1	1	0		,	,		•				
0 to 1400**	400 to 1800	-200 to 400	1	1	1	1		0	0		0				
		-													•
		Linearis	ation	ON	0	4									
		Linearis	satio	n off	1	•									
	N. 15				1	0.10			1						
* n/a for type		_				CJC			-						
** n/a for type	es K, J, N and	E				CJ	C of	т 1							

Then select the required setting from the table below for switch S2.

		Switch S2													
Thermocouple															
	1	1 2 3 4 5 6 7 8 9 10 11 12													
All Ranges	0	1	0	0	1	1	1	0	0	0	0	0			



5.6 RTD Input

Select the range from the table below and set Switch S1 to the required values.

Switch S1											
1	2	3	4	5	6	7	8	9	10	11	12
0	0	0	0		0	0		1	0	0	1
0	0	0	1			ب					
0	0	1	0								
0	0	1	1								
0	1	0	0								
0	1	0	1								
0	1	1	0								
0	1	1	1								
1	0	0	0								
1	0	0	1								
1	0	1	0								
1	0	1	1								
1	1	0	0								
1	1	0	1								
1	1	1	0		4	7			•		
1	1	1	1		0	0		1	0	0	
			ſ								
			•								lacksquare
satio	n off	1						PT	1000	1	
ı			- n A	!		1					
	KI					←					
Į.		KI	υ 3	wire	7						
	0 0 0 0 0 0 0 0 1 1 1 1 1 1	0 0 0 0 0 0 0 0 0 1 0 1 0 1 0 1 0 1 0 1	0 0 0 0 0 0 0 0 0 0 0 1 0 0 1 0 0 1 0 1	0 0 0 0 0 0 0 0 0 0 0 0 0 1 0 0 0 1 1 0 0 0 1 0 0 0 1	1 2 3 4 5 0 0 0 0 0 0 0 0 1 0 0 0 1 0 0 0 1 1 0 1 0 0 0 1 1 0 0 1 1 0 0 1 1 1 1 0 0 0 1 0 1 1 1 0 0 1 1 0 1 1 1 1 0 0 1 1 1 1 1 1 0 0 1 1 1 1 1 1 1 0 1 1 1 1 1 1 1 1 ation ON 0 sation off 1	1 2 3 4 5 6 0 0 0 0 0 0 0 0 1 0 0 0 1 0 0 0 1 1 0 1 0 0 0 1 1 0 0 1 1 0 0 1 1 1 1 0 0 0 1 0 1 1 1 0 0 1 1 1 0 0 1 1 1 1 1 1 0 0 1 1 1 1 1 1 0 0 1 1 1 1 1 1 1 0 0 1 1 1 1 1 1 0 0 1 1 1 1 1 1 0 0 1 1 1 1 1 1 0 0 1 1 1 1 1 1 0 0 1 1 1 1 1 1 0 0 1 1 1 1 1 1 0 0 1 1 1 1 1 1 1	1 2 3 4 5 6 7 0 0 0 0 0 0 0 0 0 1 0 0 0 1 0 0 0 1 1 0 1 0 0 0 1 1 0 0 1 1 0 0 1 1 1 1 0 0 0 1 0 1 1 1 0 0 1 1 0 0 1 1 1 1 0 0 1 1 1 1 1 1 0 0 1 1 1 1 1 1 0 0 1 1 1 1 1 1 1 0 0 0 ation ON 0 sation off 1	1 2 3 4 5 6 7 8 0 0 0 0 0 0 0 0 1 0 0 1 0 0 0 1 1 0 1 0 0 0 1 1 0 0 1 1 0 0 1 1 1 1 0 0 0 1 0 1 1 1 0 0 1 1 0 0 1 1 1 1 1 1 1 0 0 1 1 1 1 1 1 0 0 1 1 1 1 1 1 1 0 1 1 1 1 1 1 1 0 1 1 1 1 1 1 1 0 1 1 1 1	1 2 3 4 5 6 7 8 9 0 0 0 0 0 0 0 0 0 1 0 0 0 1 0 0 0 1 1 0 1 0 0 0 1 1 0 0 1 1 0 1 0 0 1 1 0 0 0 1 0 0 1 1 0 0 1 1 0 0 1 1 1 1 0 0 1 1 1 1 1 1 0 0 1 1 1 1 1 1 1 0 1 1 1 1	1 2 3 4 5 6 7 8 9 10 0 0 0 0 0 0 0 0 0 1 0 0 0 1 0 0 0 1 1 0 1 0 0 0 1 1 0 0 1 1 0 0 1 1 1 1 0 0 0 1 0 1 1 1 1 0 0 1 1 1 1 1 1 0 0 1 1 1 1 1 1 1 0 0 0 1 1 1 1 1 1 1 0 0 1 1 1 1 1 1 1 0 0 0 PT100 PT1000	1 2 3 4 5 6 7 8 9 10 11 0 0 0 0 0 0 0 0 0 1 0 0 0 0 1 1 0 1 0 0 0 1 1 0 0 0 1 1 1 1 0 0 0 1 1 0 0 1 1 0 0 1 1 0 0 1 1 1 1 1 1 1 0 0 1 1 1 1 1 1 0 0 1 1 1 1 1 1 0 0 1 1 1 1

And then select the required setting from the table below for switch S2.


RTD					,	Swite	ch S	2				
	1	2	3	4	5	6	7	8	9	10	11	12
2 Wire RTD	0	1	0	0	1	0	0	1	0	0	0	1
3 Wire RTD	0	1		0	0		0	0	1	0	0	1
4 Wire RTD	0	1	0	0	0	0	0	1	0	1	0	0



5.7 Output Configuration

Output type is selected with Switch S3.

Output Type	S3 Position
mA Source	Off
Voltage	On

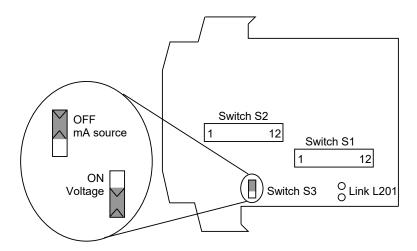



6. CALIBRATING THE CMCP730D

When the unit is shipped the CMCP730D will be calibrated for the input and output types and ranges noted on the side label. If this label is blank then the unit will be calibrated for 4-20mA input and 4-20mA source output. The side label also indicates the setpoints and relay operation. If these are blank, the default settings are:

Relay 1 energized above 16.00mA (Set Point 1), Led 1 on when Relay 1 energized Relay 2 energized below 8.00mA (Set Point 2), Led 2 on when Relay 2 energized Input units are mA to 2 decimal places. Hysteresis is 0.2mA. Averaging is on, high burnout. Power on delay is 2 seconds; all other time delays are 0.5 seconds.

6.1 Main menu and Set Point menu

To access the set point menu push and hold both buttons until OK is displayed.

These are the set point menu options, use raise and lower buttons to cycle through:

```
1. SETPOINT 1 (sec 6.2)
2. SETPOINT 2 (sec 6.2)
```

To <u>access the main menu</u> a sequence of button presses must be entered.

Push and hold in both buttons then: release raise, hold in both, release lower, hold in both, release lower, hold in both, release raise, release lower

These are the main menu options, use raise and lower buttons to cycle through:

1. SETPOINT 1	(sec 6.2)	12. INPUT ZERO	(sec 6.7)
2. SETPOINT 2	(sec 6.2)	13. HYS 1	(sec 6.2)
3. RELAY 1	(sec 6.3)	14. HYS 2	(sec 6.2)
4. RELAY 2	(sec 6.3)	15. OUTPUT OPTIONS	(sec 6.9)
5. LED 1	(sec 6.4)	POWER ON DELAY	(sec 6.10)
6. LED 2	(sec 6.4)	17. OFF TO ON 1 (delay)	(sec 6.10)
7. OUTPUT SPAN	(sec 6.5)	18. ON TO OFF 1 (delay)	(sec 6.10)
8. OUTPUT ZERO	(sec 6.5)	19. ON DELAY 1	(sec 6.10)
INPUT UNITS	(sec 6.6)	20. OFF TO ON 2 (delay)	(sec 6.10)
10. RELAY TEST	(sec 6.8)	21. ON TO OFF 2 (delay)	(sec 6.10)
11. INPUT SPAN	(sec 6.7)	22. ON DELAY 2	(sec 6.10)

To access the sub menu of one of the main menu options, use raise or lower to cycle to the option required then push and release both buttons. Change the parameter as required.

To return to the main menu, push and release both buttons.

To exit from the main menu and return to run mode, press and hold both buttons for 2 seconds until OK is displayed on the screen.

After two minutes of inactivity from the front buttons when the main menu (or a sub menu) had been accessed, a timeout will occur and the unit will automatically return to run mode.

In run mode, briefly pressing and releasing both buttons will scroll the input value across the display with the units. Any latched relays will also be reset.

6.2 Set Points 1 and 2, Hysteresis Points 1 and 2


The default value for Set Point 1 is 16.00mA and Set Point 2 is 8.00mA, the default value for hysteresis points is 0.2mA. These values can be adjusted in their submenus, and a description of how they interact follows in the next section. Note that the value for hysteresis is the amount away from the Set Point, rather than a point in itself.

6.3 Relay 1 and Relay 2

Each relay can function in one of the following ways (same options for relay 2).

RLY 1 ON ABOVE SP1 (default for Relay 1)
RLY 1 OFF ABOVE SP1
RLY 1 ON BELOW SP1 (default for Relay 2)
RLY 1 OFF BELOW SP1
RLY 1 LATCH ON ABOVE SP1
RLY 1 LATCH OFF ABOVE SP1
RLY 1 LATCH ON BELOW SP1
RLY 1 LATCH OFF BELOW SP1

Latched relays are reset by pushing & releasing both buttons together in run mode.

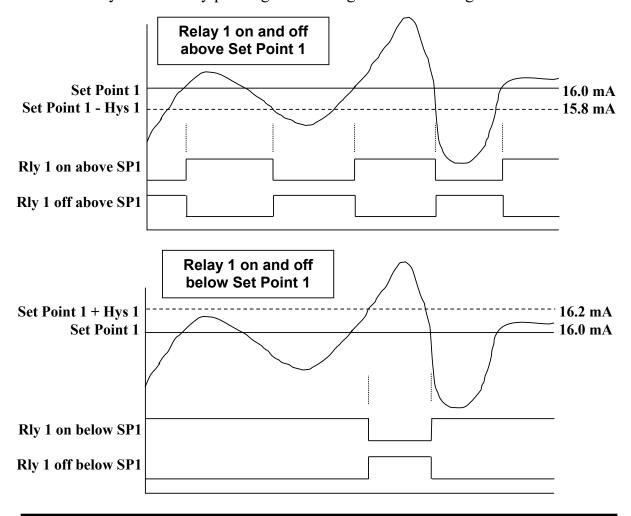

6.4 Led 1 and Led 2

The leds on the front panel can be configured in the following ways:

LED 1 ON WHEN RLY 1 ON	(default)
LED 1 ON WHEN RLY 1 OFF	
LED 2 ON WHEN RLY 2 ON	(default)
LED 2 ON WHEN RLY 2 OFF	

6.5 Output Span and Output Zero

Setting of the zero and span points is non-interactive, so each point need only be set once. Default output values are approximately 4-20mA or 2-10V out. A typical calibration sequence would be as follows:

Display	Action				
7.OUTPUT SPAN	Apply full scale input.				
/.OUTPUT SPAN	Press and release both buttons together				
SPAN ADJUST	Press raise/lower buttons to adjust output value until correct				
SPAN ADJUST	Press and release both buttons together				
7.OUTPUT SPAN	Press raise button to change main menu item to				
	8.OUTPUT ZERO				
8.OUTPUT ZERO	Apply zero scale input				
8.001PU1 ZERO	Press and release both buttons together				
ZERO ADJUST	Press raise/lower buttons to adjust output value until correct				
ZERO ADJUST	Press and release both buttons together				

When the unit is used to convert a thermocouple input it is important when calibrating to ensure that the thermocouple simulator employed is switched to automatic cold junction compensation and is at the same ambient temperature as the CMCP730D. Note that this is not always easy to achieve, especially if the CMCP730D is mounted in a warm cabinet. An alternative method is to use an icepoint reference and a mV source.

6.6 Input Units

The following units are available to represent the input signal.

```
%, mA, V, A, mV, °C, OHM, blank (default: mA, 2 decimal places)
```

The number of decimal places can be chosen to allow a bigger input range (with lower resolution) to be represented.

2 decimal places (-327.68 to 327.67) or 1 decimal place (-3276.8 to 3276.7)

6.7 Input Span and Zero

In run mode the front panel display shows the value of the input to the CMCP730D. Values can be adjusted to correspond to the full scale and zero scale input values used when Output Span and Output Zero were adjusted.

The default Input Span value is 20.00mA, and Input Zero value is 4.00mA.

6.8 Relay Test

This option allows the relays and leds to be tested.

```
RLY 1 OFF RLY 2 OFF (both leds will be off)
RLY 1 OFF RLY 2 ON (just led 2 on)
RLY 1 ON RLY 2 OFF (just led 1 on)
RLY 1 ON RLY 2 ON (both leds on)
```

Note that the unit will automatically timeout after two minutes of inactivity from the front buttons and return to run mode.

6.9 Output Options

Averaging and burnout options can be selected. To restore the default values, choose DEFAULT VALUES then press and release both buttons to return to the main menu. From that point on, all values will have returned to defaults.

```
AVERAGE ON HIGH BURNOUT
AVERAGE ON LOW BURNOUT
AVERAGE OFF HIGH BURNOUT
AVERAGE OFF LOW BURNOUT
DEFAULT VALUES
```

High burnout values are approximately 23mA or 11.5V. Low burnout values are approximately 0mA or 0V.

Averaging is carried out using the following algorithm (a weighted average of the last eight readings, with each new reading every 20 milliseconds):

New Average =
$$\underbrace{\text{New Reading} + (7 \times \text{Old Average})}_{8}$$

6.10 Relay Time Delays


There are seven time delays available. The maximum values are 1310.7 seconds, with a resolution of 20 milliseconds.

16. POWER ON DELAY (default 2 seconds)

After power on, relays cannot trip during this time delay


17. OFF TO ON 1 (default 0.5 seconds) 20. OFF TO ON 2 (default 0.5 seconds)

The trip condition must be seen for this delay before the relay can trip (see picture below).

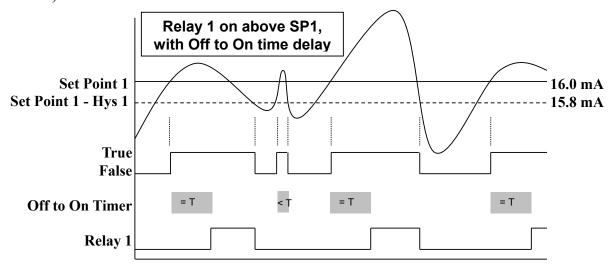


18. ON TO OFF 1 (default 0.5 seconds) 21. ON TO OFF 2 (default 0.5 seconds)

The trip condition must not be seen for this delay before the relay can reset (see picture below).

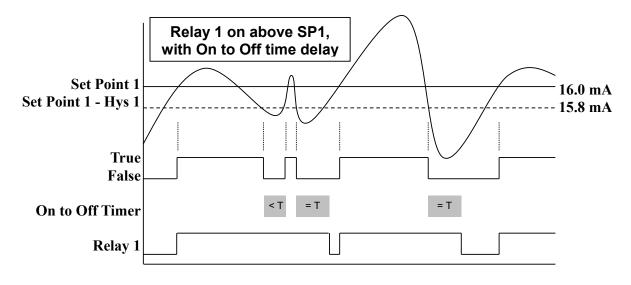


19. ON DELAY 1 (default 0.5 seconds) 22. ON DELAY 2 (default 0.5 seconds)

Relay must remain tripped for this delay before being allowed to reset (see picture below).

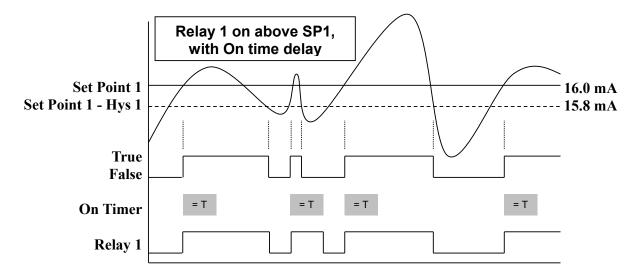

All 3 delays (or any combination) can be used at the same time if desired. Note that if the relay is tripped, both the on delay timer and the on to off delay timer can hold the relay in the tripped condition until both have expired (see picture below).

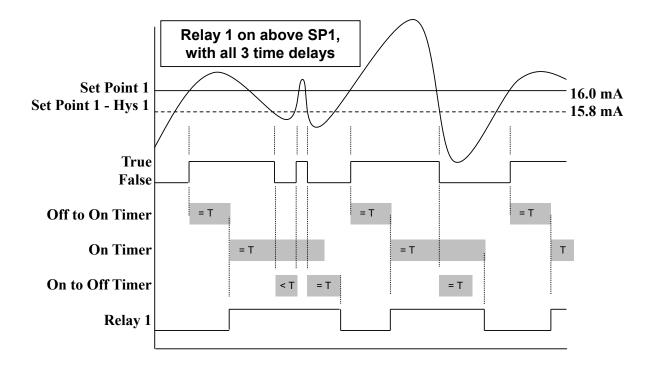

7. INSTALLATION

The CMCP730D's input and output circuits are classed as Separated Extra Low Voltage (SELV). This means that they must not be externally connected to voltages exceeding 30V ac or 60V dc, nor do they generate voltages above these limits internally. Where a higher voltage input is required a specially designed DIVIDER unit can be used to condition the input signal prior to connection to the process input terminals.

The CMCP730D unit clips directly onto 'Top Hat' (TS35) symmetrical DIN rail. Ideally, mounting orientation should be vertical. Good airflow around the unit will maximise reliability of the instrument.

The use of bootlace ferrules is recommended on wiring terminations.

Do not exceed terminal torque rating of 0.4 Nm – use an appropriate screwdriver. The unit can be removed from the DIN rail by sliding a small screwdriver into the slot at the rear of the enclosure on the lower face and gently levering the metal clip, whilst lifting the unit from the rail.

8. TROUBLESHOOTING

The CMCP730D has some built in self diagnostic functions. Errors encountered will be displayed on screen.

BURNOUT ERROR Check wiring connections of RTD or TC.

EEPROM ERROR Stored data has been corrupted. Push and release both

buttons then recalibrate the output options and values.

NO DATA ERROR PARITY ERROR ADC ERROR CJC ERROR

Switch off unit, check switch settings and wiring, then retry. If still faulty please contact supplier.

8.1 Incorrect Reading

- Check that Unit is configured for the correct Sensor
- Check that Input Scaling is as required.
- Check that Linearisation has been set correctly.
- Check that Thermocouples have correct compensation cables, and polarity.
- Check that RTD is set for correct option 2, 3 or 4 Wire.
- Check that RTD leads are connected to appropriate terminal pins.

8.2 Sensor Failure

- Check that sensor wiring is correct.
- Check Thermocouple polarity.
- Check that all RTD leads are connected to correct terminals.
- Check that the CMCP730D ALM is configured for correct sensor.
- Check that applied voltage is not out of range.
- Check that applied current is not out of range.
- Check that applied millivoltage is not out of range.

SPECIFICATIONS (@ 25°C) 9.

0 to 55 °C Operating Temperature

Operating Altitude Sea Level to 2000m

Humidity 0-90% RH Power Requirements 16 to 30Vdc DC Supply

AC Supply 16 to 32Vac

Current Consumption 55mA @ 24Vdc (20mA in & out)

> 90mA as above with both relays & leds on 85mA @ 24Vdc (maximum load, tx supply) 120mA as above with both relays & leds on

260mA for 50ms on 24Vdc power up

Transmitter Power Supply 22V to 29V @ up to 24mA

Dependant on supply voltage and load

 $\pm 0.05\%$ full scale Calibration accuracy $\pm 0.05\%$ full scale Linearity

Temperature Stability 50ppm / °C

Input Impedance:

Current Input 15 ohms Voltage Input 1 Mohm

Greater Than 10 Mohm Millivolt Input

500nA Nominal Thermocouple Burn Out Current:

Cold junction compensation accuracy ± 0.5 °C over operating range 11.5 V into a minimum of 7Kohm Maximum Voltage Output Maximum Current Output 23.0 mA into a maximum of 1Kohm

Time Response (90% of step change): $50 \text{ms} \pm 10 \text{ms}$

Mains Rated Relays 3A resistive at 240V ac

Unit has full 3 port Isolation to 1kV between Power Supply, Input and Output.

The unit can also withstand transients of 2.5kV for 50 usecs.

Dimensions 114.5 mm x 99mm x 22.5mm (H x D x W)

Mounting DIN Rail TS35

Connections Screw Clamp with pressure plate

Conductor Size 0.5 to 4.0 mm

Insulation Stripping 12 mm Maximum Terminal Torque 0.4 Nm

Weight Approx. 140g **EMC Emissions** BS EN61326 LVD Standards EN61010-1

Installation Category (IEC 664) II Pollution Degree (EN61010-1) 2 Equipment Class (IEC 536) II